

ALUTECH SYSTEMS S.R.O. TEST REPORT

SCOPE OF WORK

AAMA/WDMA/CSA 101/I.S.2/A440 TESTING ON
W72, SIDE HINGED DOOR (OUT-SWING)

REPORT NUMBER

L4430.03-109-44 R0

TEST DATE(S)

02/01/21 - 03/03/21

ISSUE DATE

10/23/23

RECORD RETENTION END DATE

03/03/25

PAGES


21

DOCUMENT CONTROL NUMBER

ATI 00499 (07/24/17)

RT-R-AMER-Test-2807

© 2017 INTERTEK

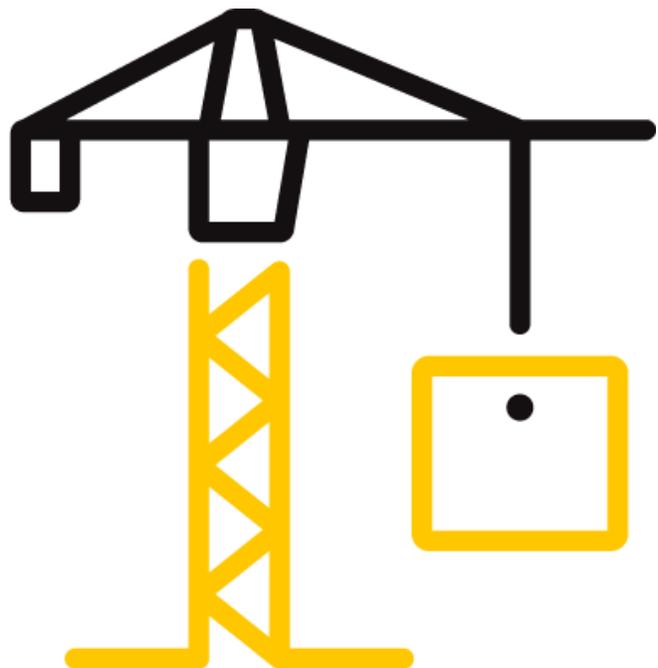

TEST REPORT FOR ALUTECH SYSTEMS S.R.O.

Report No.: L4430.03-109-44 R0

Date: 10/23/23

REPORT ISSUED TO

Alutech Systems s.r.o.

Úherce 165 330 23

Úherce, Czech Republic

SECTION 1

SCOPE

This report is a reissue of report No. L4430.01-109-44-R0, dated 04/15/21. This report is rendered to Alutech Systems s.r.o through written authorization. Intertek Building & Construction (B&C) perform testing in accordance with AAMA/WDMA/CSA 101/I.S.2/A440 on W72, side hinged door (out-swing). Results obtained are tested values and were secured by using the designated test method(s). Testing was conducted at Intertek B&C test facility in York, Pennsylvania. This report does not constitute certification of this product nor an opinion or endorsement by this laboratory.

SECTION 2

SUMMARY OF TEST RESULTS

TITLE	RESULTS
AAMA/WDMA/CSA 101/I.S.2/A440-17	Class CW – PG80 1200 x 2400 (47 x 49) – SHD
Design Pressure	±3840 Pa (±80.20 psf)
Air Infiltration at 300 Pa (6.27 psf)	0.5 L/s/m ² (0.10 cfm/ft ²)
Water Penetration Resistance Test Pressure	720 Pa (15.04 psf)

Reference Intertek-ATI Report No. L4430.01-109-44, dated 04/15/21 for complete test specimen description and test results.

For INTERTEK B&C:

COMPLETED BY:	Richard E. Hartman III	REVIEWED BY:	Timothy J. McGill
TITLE:	Team Lead	TITLE:	Senior Project Engineer
SIGNATURE:		SIGNATURE:	
DATE:	10/23/23	DATE:	10/23/23

MMN:sar

This report is for the exclusive use of Intertek's Client and is provided pursuant to the agreement between Intertek and its Client. Intertek's responsibility and liability are limited to the terms and conditions of the agreement. Intertek assumes no liability to any party, other than to the Client in accordance with the agreement, for any loss, expense or damage occasioned by the use of this report. Only the Client is authorized to permit copying or distribution of this report and then only in its entirety. Any use of the Intertek name or one of its marks for the sale or advertisement of the tested material, product or service must first be approved in writing by Intertek. The observations and test results in this report are relevant only to the sample(s) tested. This report by itself does not imply that the material, product, or service is or has ever been under an Intertek certification program.