

# ALUTECH SYSTEMS S.R.O. THERMAL PERFORMANCE TEST REPORT

**SCOPE OF WORK**

W72 FIXED WINDOW

**REPORT NUMBER**

L3931.02-116-46 R0

**TEST DATE**

04/14/21

**ISSUE DATE**

06/26/23


**PAGES**

16

**DOCUMENT CONTROL NUMBER**

RTTDS-R-AMER-Test-2822(a) (07/01/20)

©2017 INTERTEK

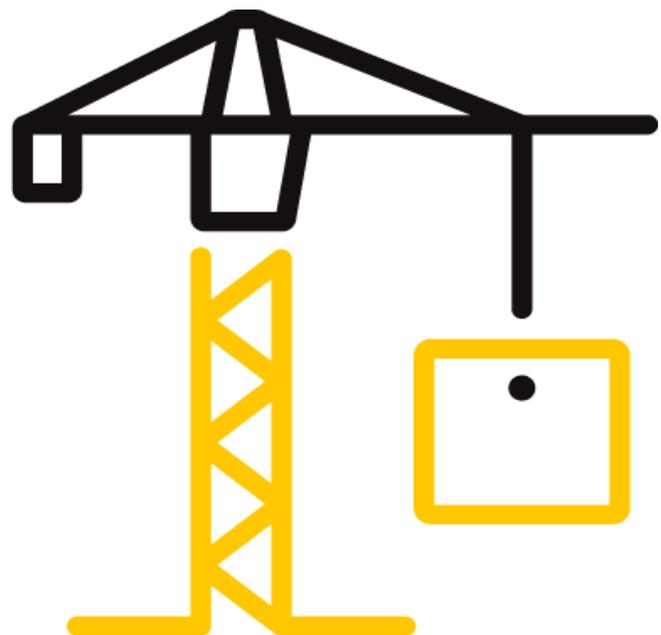

**TEST REPORT FOR ALUTECH SYSTEMS S.R.O.**

Report No.: L3931.02-116-46 R0

Date: 06/26/23

**SECTION 2**

**SUMMARY OF TEST RESULTS**

Standardized U-factor (Ust): 0.17 Btu/hr·ft<sup>2</sup>·F (CTS Method)

**SECTION 3**

**TEST SPECIMEN SUMMARY**

<b>SERIES/MODEL</b>	W72 Fixed Window
<b>TYPE</b>	Fixed
<b>OVERALL SIZE</b>	47-1/4" x 59" (1200 mm x 1499 mm) (Model Size)
<b>NFRC STANDARD SIZE</b>	47.2" x 59.1" (1200 mm wide x 1500 mm high)

**SECTION 4**

**TEST METHOD**

The specimens were evaluated in accordance with the following:

**NFRC 102-2020**, Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems

**SECTION 5**

**MATERIAL SOURCE/INSTALLATION**

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side.

**SECTION 6**

**LIST OF OFFICIAL OBSERVERS**

<b>NAME</b>	<b>COMPANY</b>
Shon W. Einsig	Intertek B&C
Ryan P. Moser	Intertek B&C