

# ALUTECH SYSTEMS S.R.O. THERMAL PERFORMANCE TEST REPORT

**SCOPE OF WORK**

W72 SWING DOOR

**REPORT NUMBER**

L3937.02-116-46 R0

**TEST DATE**

01/29/21

**ISSUE DATE**

06/26/23


**PAGES**

17

**DOCUMENT CONTROL NUMBER**

RTTDS-R-AMER-Test-2822(a) (07/01/20)

©2017 INTERTEK

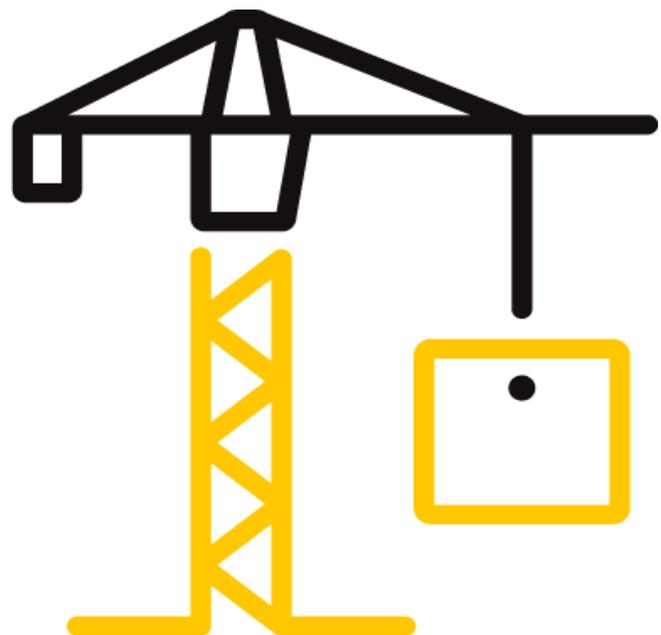

## TEST REPORT FOR ALUTECH SYSTEMS S.R.O.

Report No.: L3937.02-116-46 R0

Date: 06/26/23

### SECTION 2

#### SUMMARY OF TEST RESULTS

Standardized U-factor (Ust): 0.25 Btu/hr·ft<sup>2</sup>·F (CTS Method)

### SECTION 3

#### TEST SPECIMEN SUMMARY

<b>SERIES/MODEL</b>	W72 Swing Door
<b>TYPE</b>	Swinging Door with Frame
<b>OVERALL SIZE</b>	37-7/8" x 82-1/4" (962 mm x 2089 mm) (Model Size)
<b>NFRC STANDARD SIZE</b>	37.8" x 82.3" (960 mm wide x 2090 mm high)

### SECTION 4

#### TEST METHOD

The specimens were evaluated in accordance with the following:

**NFRC 102-2020**, Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems

### SECTION 5

#### MATERIAL SOURCE/INSTALLATION

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side.

### SECTION 6

#### LIST OF OFFICIAL OBSERVERS

<b>NAME</b>	<b>COMPANY</b>
Shon W. Einsig	Intertek B&C
Ryan P. Moser	Intertek B&C