

ALUTECH SYSTEMS S.R.O. THERMAL PERFORMANCE TEST REPORT

SCOPE OF WORK

W72 TILT AND TURN

REPORT NUMBER

L3933.03-116-46 R0

TEST DATE

01/29/21

ISSUE DATE

06/26/23


PAGES

17

DOCUMENT CONTROL NUMBER

RTTDS-R-AMER-Test-2822(a) (07/01/20)

©2017 INTERTEK

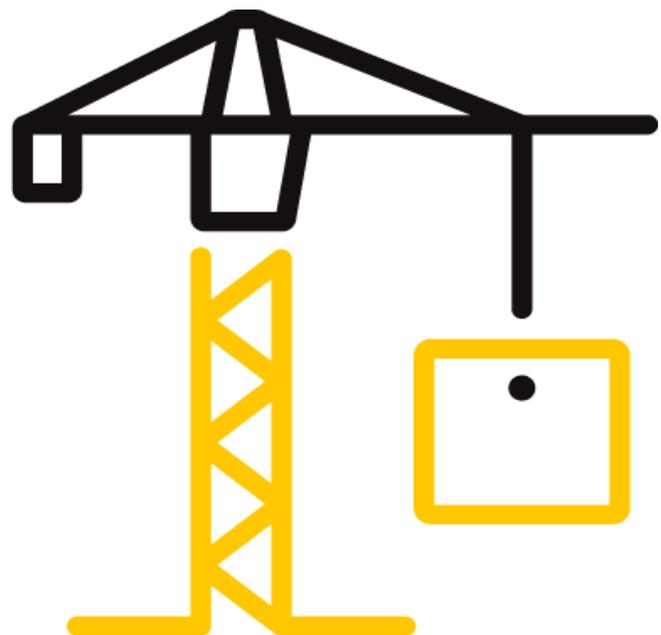

TEST REPORT FOR ALUTECH SYSTEMS S.R.O.

Report No.: L3933.03-116-46 R0

Date: 06/26/23

SECTION 2

SUMMARY OF TEST RESULTS

Standardized U-factor (Ust): 0.21 Btu/hr-ft²·F (CTS Method)

SECTION 3

TEST SPECIMEN SUMMARY

SERIES/MODEL	W72 Tilt and Turn
TYPE	Dual-Action
OVERALL SIZE	47-1/4" x 59" (1200 mm x 1499 mm) (Model Size)
NFRC STANDARD SIZE	47.2" x 59.1" (1200 mm wide x 1500 mm high)

SECTION 4

TEST METHOD

The specimens were evaluated in accordance with the following:

NFRC 102-2020, Procedure for Measuring the Steady-State Thermal Transmittance of Fenestration Systems

SECTION 5

MATERIAL SOURCE/INSTALLATION

The test sample was installed in a vertical orientation, the exterior of the specimen was exposed to the cold side.

SECTION 6

LIST OF OFFICIAL OBSERVERS

NAME	COMPANY
Shon W. Einsig	Intertek B&C
Ryan P. Moser	Intertek B&C